



Optional Extras



User Remote Control - FRC/USER

The frc/user remote control is a convenient method for the user to control the lighting remotely. Lights can be temporarily overridden ON or OFF and in cases where the lighting control is dimmable, dimmed UP or DOWN. In addition, up to six preset light levels can be stored and recalled.

Note: Unlike the FRC/SET remote control the frc/user remote control can not be used to setup or change occupancy time-out settings.





Increasing Occupancy Coverage - FNH/AUX/S

Occupancy coverage can be increased by adding up to a maximum of five aux sensor heads (FNH/AUX/S) to your existing sensor head. The FNH/AUX/S can be ordered separately and comes complete with a 'Y' adaptor to facilitate connection.

A connecting lead may also be required, part number fslXX (XX = length /5m).

Sensor head and occupancy detection performance

FNH400/S

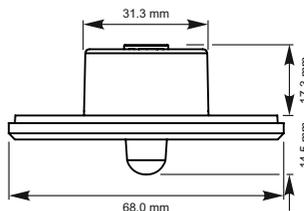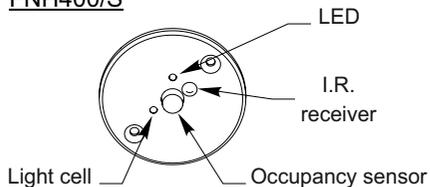


The sensor head fits into a 32mm diameter hole, with 50.8mm pitched fixing holes.


The sensor head has a rectangular occupancy detection range broadly 9m x 7m at a ceiling height of 2.5m (Longest length of detection aligning with the fixing holes). As the ceiling height increases so will the overall detection area but sensitivity to small movements will decrease.

Note: Make sure that the sensor is not adjacent to circulating air, heaters or lamps.

Detection Zone



Detection Zone

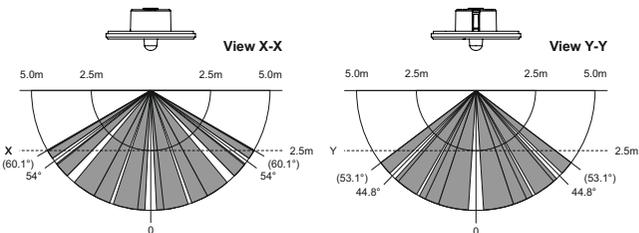

Note: For safe operation it is advisable to extend occupancy coverage to cover the wall switch. In this way, operating the switch to 'SENSOR' position ensures the lights turn ON.

The X-Y cross-sectional diagram shows the detection area. The differences in the detection zone patterns indicate the projections of the 16 lenses with a single focal point. Movement of an object with higher than background temperature, between the detection zones, will be detected.

Supply Voltage :12V DC

Material :White PA6 UL94 V-0 rated, Non-halogen


Operating range :-10°C to 40°C

IP Rating :IP20

Compliance :2014/35/EU :2014/30/EU

FNH400/S Tamper resistant occupancy sensor head


Working in conjunction with fnc type controllers, the FNH400/S sensor head provides additional sensory data from the room. This takes the form of occupancy, light level and received instructions from a remote control such as the FRC/USER remote control.

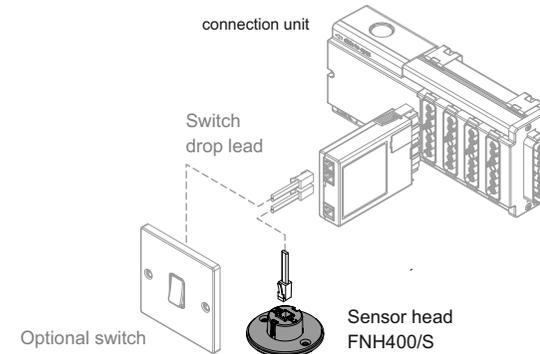


Considerations before installation

The FNH400/S sensor head detects both occupancy and light level. However, conditions for optimum light sensing should always have priority over those for occupancy coverage. To achieve effective light level control, select only an area where the daylight contribution, though changeable, is significant and remains consistent across the area.

X As lamp output across the circuit must be common, it is not possible to provide the 'optimal' luminosity for all areas when some receive more daylight than others.

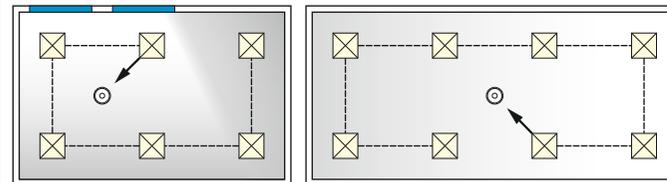


✓ Try to split into zones where the changes in daylight are reasonably consistent. Darker areas may then be controlled via alternative means such as on/off without consideration to light level. You may even consider sufficient natural light reaches

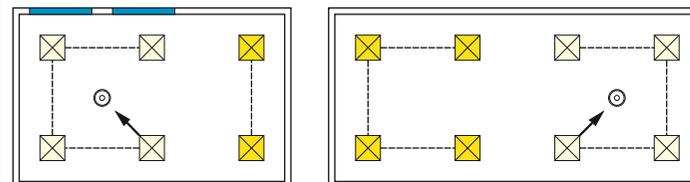

these areas to justify a second light level sensing circuit.

Note: Make sure that the sensor is not adjacent to circulating air, heaters or lamps. Always fit the sensor head as close as possible to the centre of the group of lights under its control.

Setting Up



Setup Remote Control - FRC/SET

The sensor can only be setup by using an FRC/SET remote control - ordered separately.

Full instructions for setting up the sensor are supplied with the FRC/SET remote control.



flex7 Limited, Ruscombe Business Park, Ruscombe Lane, Twyford, Berkshire RG10 9JW, UK

Telephone: +44 (0) 20 8580 1066 Fax: +44 (0) 20 8580 1062

Website: www.flex7.co.uk Email: info@flex7.co.uk

Leaflet reference number: 22/127 issue 1 13/01/2026

